

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2018_11_14(4)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2018. 11. 14. 15:04:04

Chart:

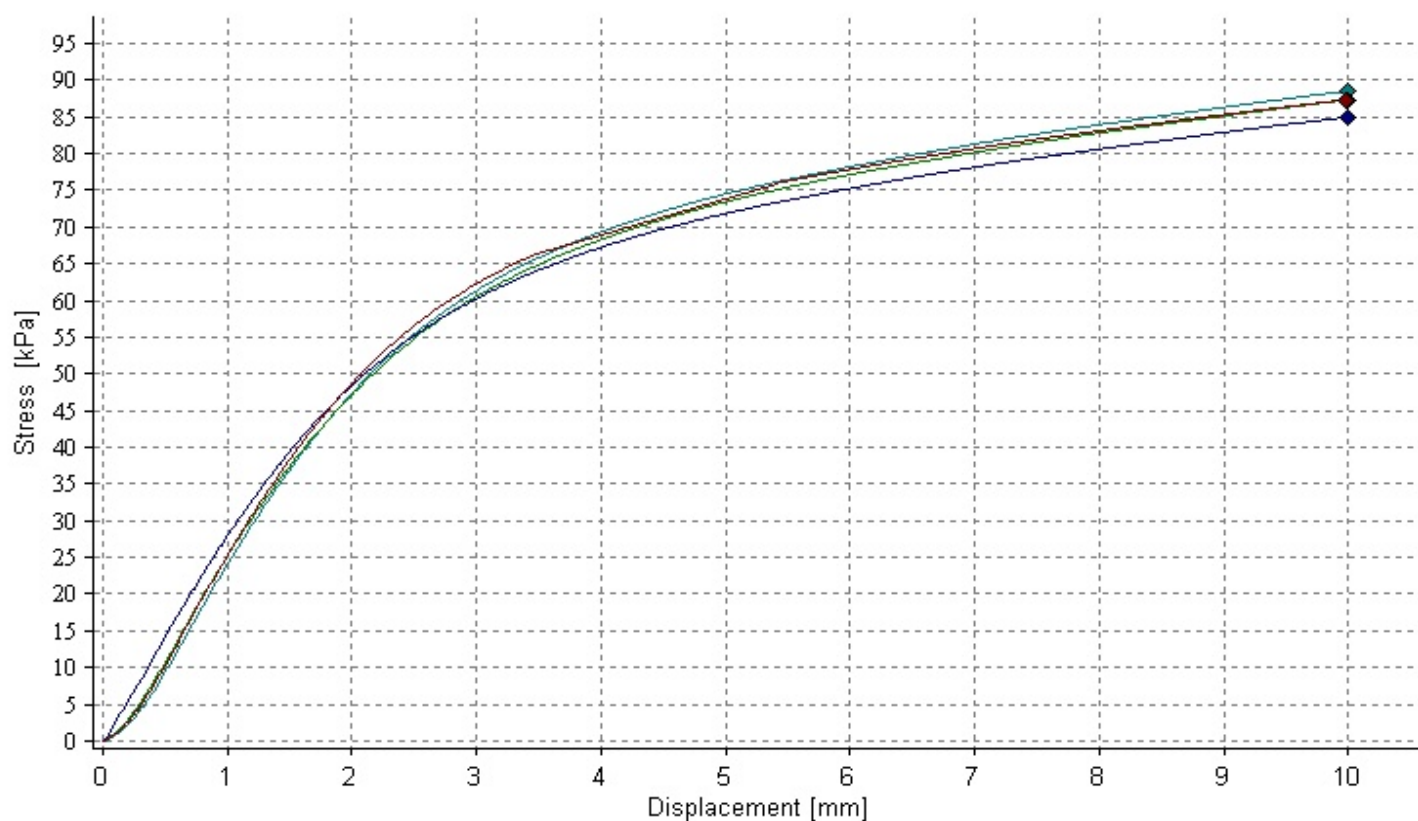

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2018_11_14 (5)	88,54	9,99
P80/2018_11_14 (6)	87,36	10,00
P80/2018_11_14 (5)	84,99	9,99
P80/2018_11_14 (6)	87,38	9,99
Max.	88,54	10,00
Min.	84,99	9,99
Mean	87,07	9,99