

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2019_03_18


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019. 03.18. 17:16:14

Chart:

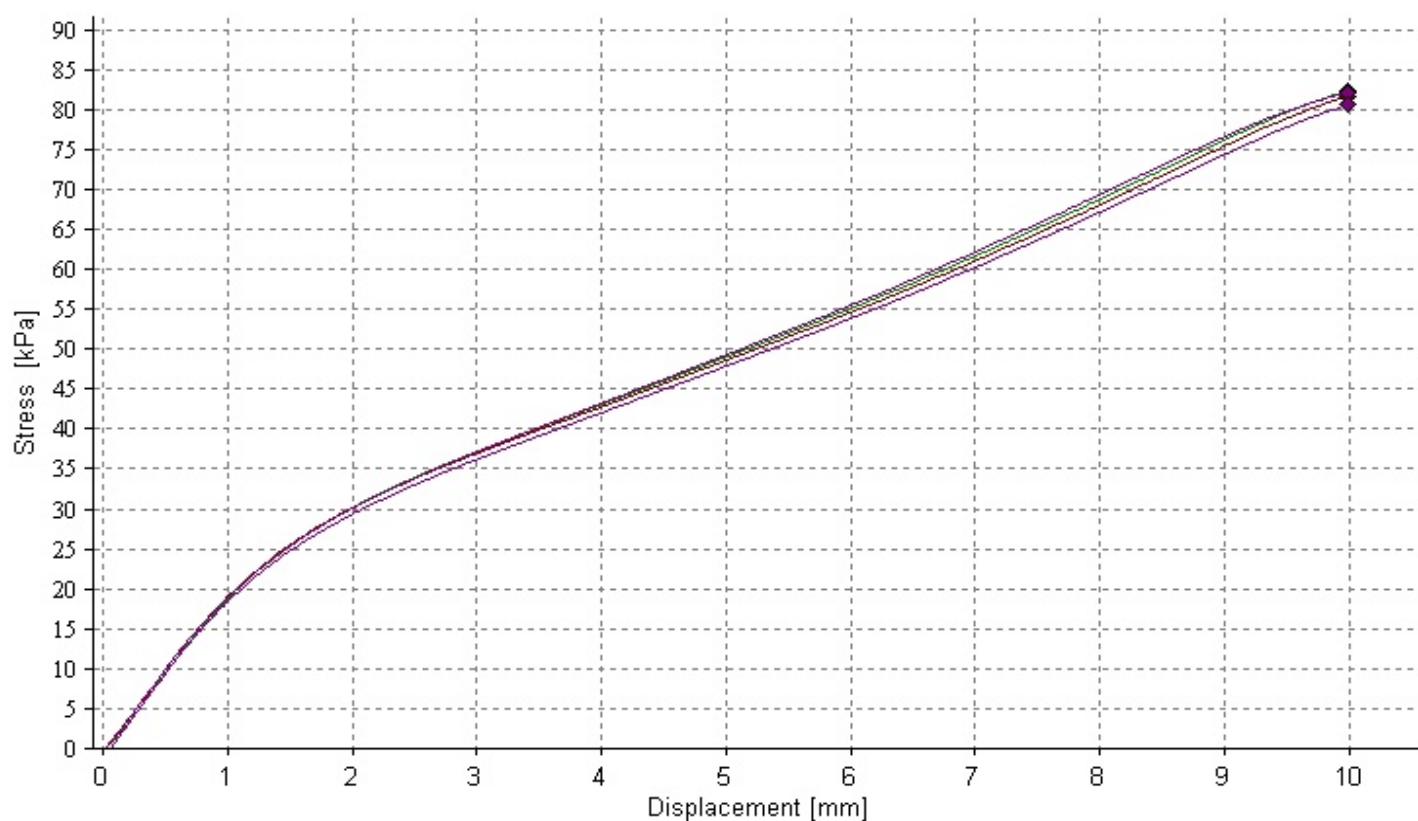

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2019_03_18 (5)	82,30	9,99
P80/2019_03_18 (6)	81,62	9,98
P80/2019_03_18 (7)	82,13	9,99
P80/2019_03_18 (8)	80,54	9,99
Max.	82,30	9,99
Min.	80,54	9,98
Mean	81,65	9,99