

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2020_07_20(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2020. 07. 20. 13:02:40

Chart:

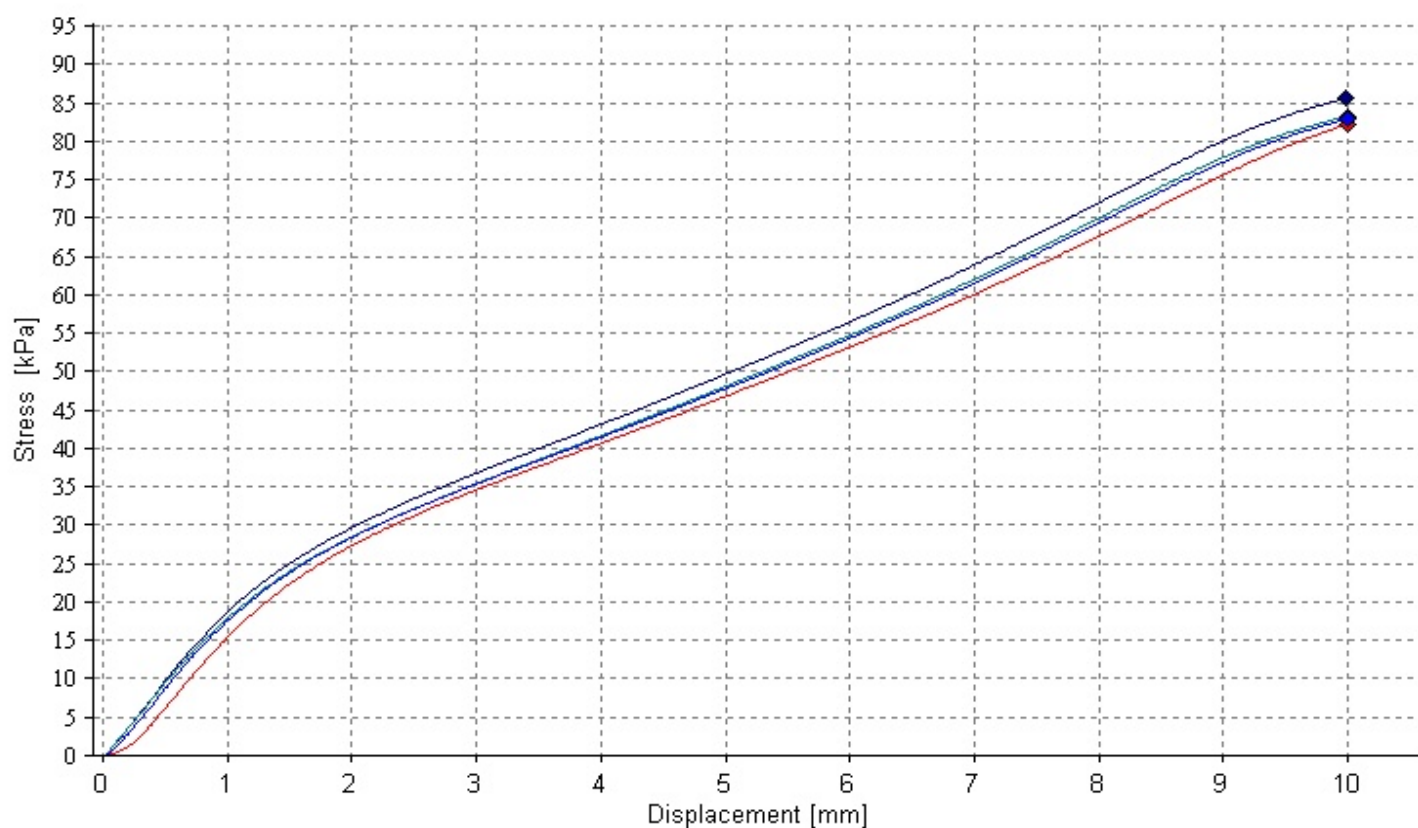

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2020_07_20 (1)	82,24	9,99
P80/2020_07_20 (2)	85,66	9,99
P80/2020_07_20 (3)	83,28	10,00
P80/2020_07_20 (4)	82,91	10,00
Max.	85,66	10,00
Min.	82,24	9,99
Mean	83,52	9,99